


METER PIT FOR 4" DOMESTIC W/3" or 4" METER & 4" to 8" FIRE LINES

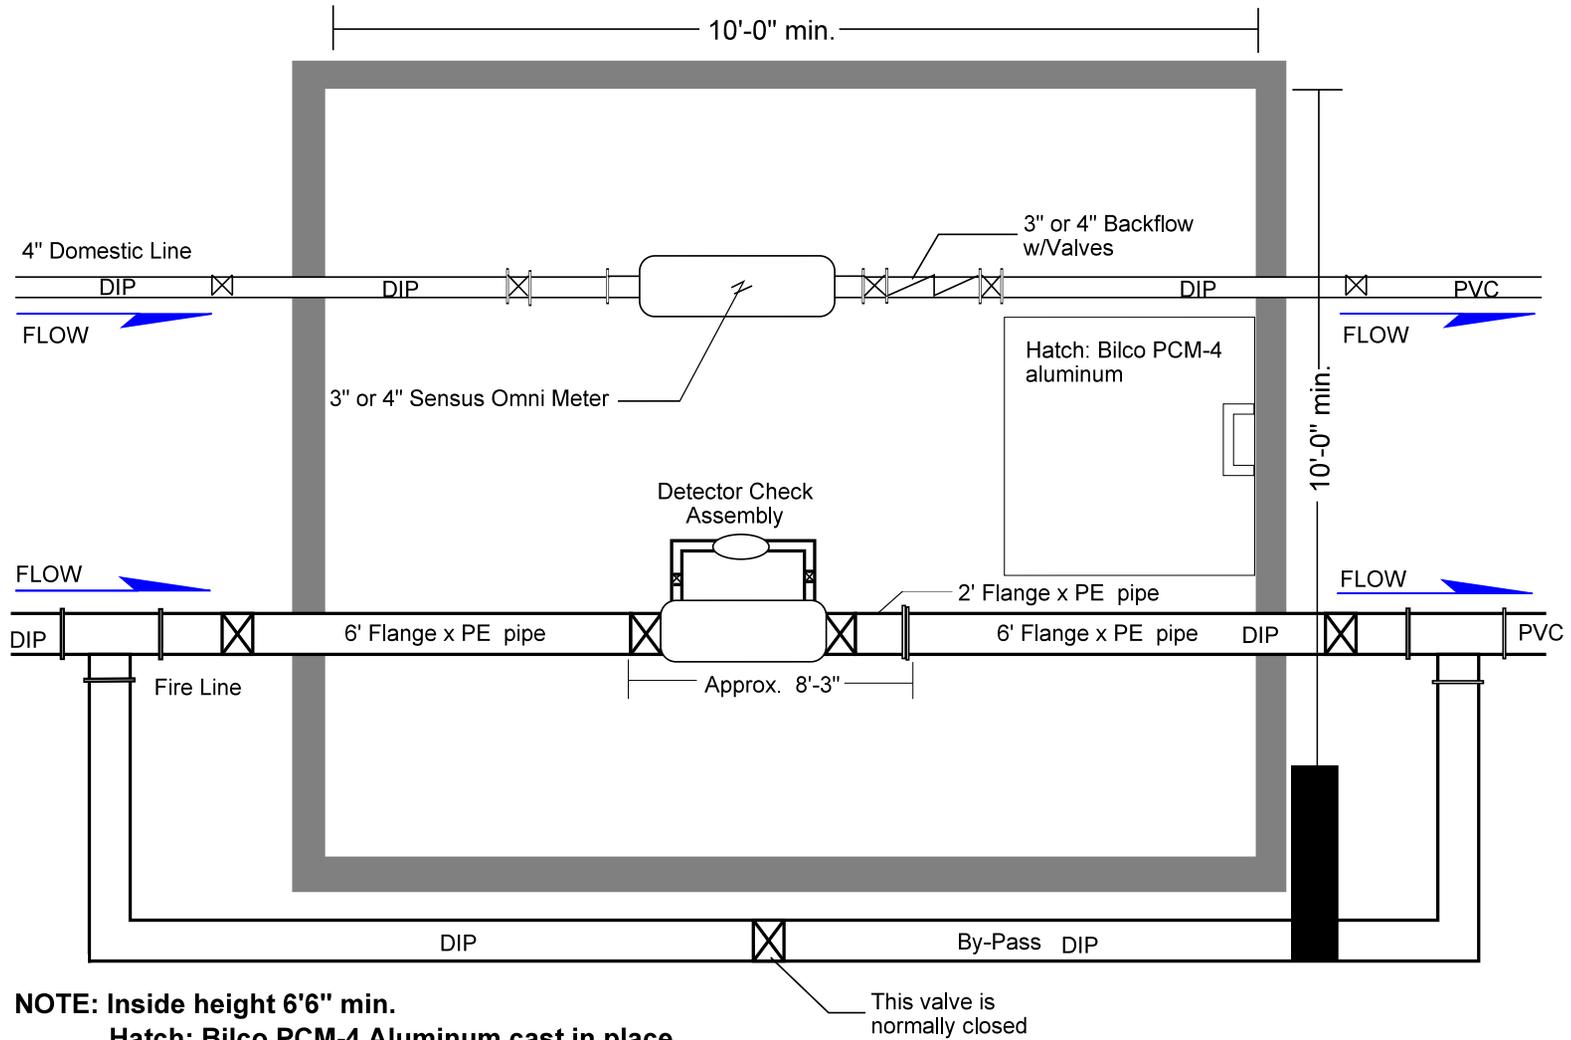

**NOTE: Inside height 6'6" min.
Hatch: Bilco PCM-4 Aluminum cast in place
36" min. Width**

NOTES:

1. Hatch location may be moved with Authority approval.
2. Mega-lugs must be used on all fittings and valves or the fittings must be rodded (4 min.) and anchored in concrete.
3. Concrete Thrust Blocks must be used on all underground bends & tee's.
4. Owner to purchase, take delivery and install the 3"/4" meter. Authority personnel will inspect installation.